

Product Environmental Profile

Standard auxiliary contact, circuit breaker status OF/SD/SDE/SDV, 1 changeover contact type, screwless spring terminals






General information

| | |
|----------------------------|---|
| Reference product | Standard auxiliary contact, circuit breaker status OF/SD/SDE/SDV, 1 changeover contact type, screwless spring terminals - 29450 |
| Description of the product | Auxiliary indication contact. It clips into slots behind the front cover of the circuit breakers NSX 100 to 630A (or Vigi module). This common-point changeover contact provides remote circuit-breaker status. |
| Functional unit | Provide to the auxiliary circuit the status of the circuit breaker (open/closed/tripped). Use Rate = 100%, Reference Lifetime = 20 years, according to IEC 60947-2. |



Constituent materials

| | |
|------------------------|---|
| Reference product mass | 25,5 g including the product, its packaging and additional elements and accessories |
|------------------------|---|

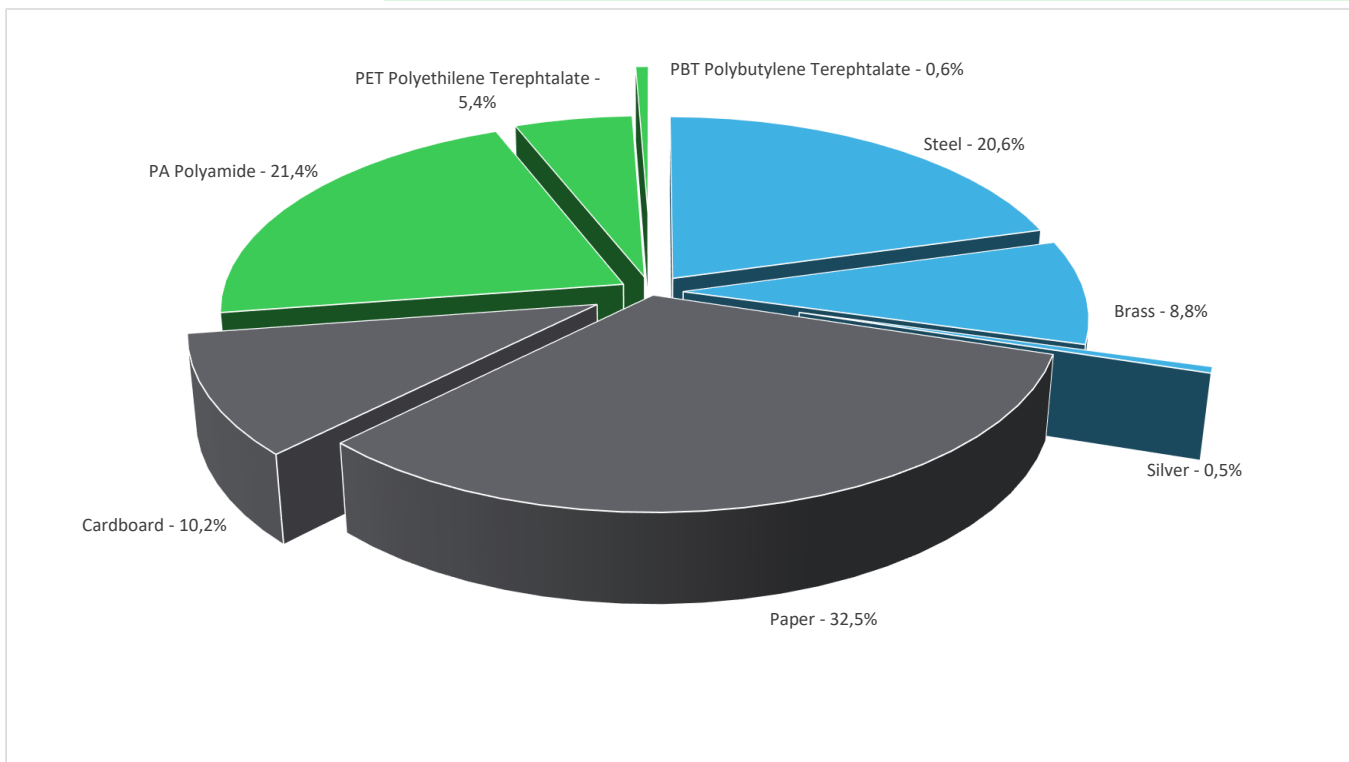

| | |
|----------|-------|
| Plastics | 27,4% |
| Metals | 29,9% |
| Others | 42,7% |



Substance assessment

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website
<https://www.se.com/ww/en/work/support/green-premium/>



Additional environmental information

| | | | |
|-------------|--------------------------|------------|---|
| End Of Life | Recyclability potential: | 56% | Recyclability rate has been calculated based on REEECYLAB tool developed by Ecosystem, for components/materials not covered by the tool, data from the "ECO'DEEEE recyclability and recoverability calculation method" was taken. If no data was found a conservative assumption was used (0% recyclability). |
|-------------|--------------------------|------------|---|

Environmental impacts

| | | | | |
|----------------------------------|---|---|---|---|
| Reference service life time | 20 years | | | |
| Product category | Other equipments - Passive product - continuous operation | | | |
| Installation elements | No special components needed during the installation phase. The disposal of the packaging materials is accounted for during this phase (including transport to disposal). | | | |
| Use scenario | load rate / rated current (In): 30 % of In percentage of utilization time: 100% | | | |
| Technological representativeness | Auxiliary indication contact. It clips into slots behind the front cover of the circuit breakers NSX 100 to 630A (or Vigi module). This common-point changeover contact provides remote circuit-breaker status. | | | |
| Geographical representativeness | Europe | | | |
| Energy model used | [A1 - A3] | [A5] | [B6] | [C1 - C4] |
| | Electricity Mix; Production mix; Low voltage; PL | Electricity Mix; Production mix; Low voltage; UE-27 | Electricity Mix; Production mix; Low voltage; UE-27 | Electricity Mix; Production mix; Low voltage; UE-27 |

Detailed results, including all the optional indicators mentioned in PCRed4, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

| Mandatory Indicators | Standard auxiliary contact, circuit breaker status OF/SD/SDE/SDV, 1 changeover contact type, screwless spring terminals - 29450 | | | | | | | | |
|--|---|----------|----------|---------------|--------------|--------------|-----------|-------------|--------------------|
| | Impact indicators | Unit | Total | Manufacturing | Distribution | Installation | Use | End of Life | Loads and Benefits |
| | | | | [A1 - A3] | [A4] | [A5] | [B1 - B7] | [C1 - C4] | [D] |
| Contribution to climate change | kg CO2 eq | 1,63E+01 | 1,24E-01 | 4,08E-03 | 1,97E-02 | 1,62E+01 | 3,87E-02 | -5,19E-02 | |
| Contribution to climate change-fossil | kg CO2 eq | 1,63E+01 | 1,15E-01 | 4,08E-03 | 1,88E-02 | 1,61E+01 | 3,87E-02 | -5,11E-02 | |
| Contribution to climate change-biogenic | kg CO2 eq | 3,07E-02 | 8,30E-03 | 0* | 8,71E-04 | 2,16E-02 | 0* | -7,41E-04 | |
| Contribution to climate change-land use and land use change | kg CO2 eq | 0,00E+00 | 0* | 0* | 0* | 0* | 0* | 0,00E+00 | |
| Contribution to ozone depletion | kg CFC-11 eq | 8,23E-08 | 1,18E-08 | 0* | 1,30E-09 | 6,91E-08 | 1,08E-10 | -7,30E-09 | |
| Contribution to acidification | mol H+ eq | 9,33E-02 | 9,09E-04 | 2,72E-05 | 7,82E-05 | 9,22E-02 | 7,71E-05 | -2,75E-04 | |
| Contribution to eutrophication, freshwater | kg (PO4) ³⁻ eq | 4,59E-05 | 1,51E-06 | 0* | 1,42E-07 | 4,42E-05 | 0* | -2,64E-07 | |
| Contribution to eutrophication marine | kg N eq | 1,06E-02 | 1,19E-04 | 1,28E-05 | 2,08E-05 | 1,05E-02 | 1,43E-05 | -4,21E-05 | |
| Contribution to eutrophication, terrestrial | mol N eq | 1,59E-01 | 1,26E-03 | 1,41E-04 | 1,58E-04 | 1,57E-01 | 1,61E-04 | -4,09E-04 | |
| Contribution to photochemical ozone formation - human health | kg COVNM eq | 3,42E-02 | 4,13E-04 | 3,57E-05 | 4,21E-05 | 3,36E-02 | 5,58E-05 | -1,28E-04 | |
| Contribution to resource use, minerals and metals | kg Sb eq | 1,13E-04 | 1,12E-04 | 0* | 0* | 1,17E-06 | 0* | -7,80E-06 | |
| Contribution to resource use, fossils | MJ | 4,16E+02 | 2,10E+00 | 5,68E-02 | 2,05E-01 | 4,12E+02 | 1,56E+00 | -7,90E-01 | |
| Contribution to water use | m3 eq | 6,52E-01 | 6,21E-02 | 0* | 8,37E-03 | 5,72E-01 | 9,57E-03 | -2,54E-02 | |

Additional indicators for the French regulation are available as well

SCHN-00976-V02.01-EN - PEP ECOPASSPORT® - Standard auxiliary contact, circuit breaker status OF/SD/SDE/SDV, 1 changeover contact type, screwless spring terminals

| Inventory flows Indicators | | Standard auxiliary contact, circuit breaker status OF/SD/SDE/SDV, 1 changeover contact type, screwless spring terminals - 29450 | | | | | | |
|---|---------|---|-----------|--------------|--------------|-----------|-------------|--------------------|
| Inventory flows | Unit | Total | Manufact. | Distribution | Installation | Use | End of Life | Loads and Benefits |
| | | | [A1 - A3] | [A4] | [A5] | [B1 - B7] | [C1 - C4] | [D] |
| Contribution to use of renewable primary energy excluding renewable primary energy used as raw material | MJ | 7,91E+01 | 4,03E-02 | 0* | 1,46E-02 | 7,90E+01 | 0* | 9,20E-02 |
| Contribution to use of renewable primary energy resources used as raw material | MJ | 1,60E-01 | 1,60E-01 | 0* | 0* | 0* | 0* | -1,61E-01 |
| Contribution to total use of renewable primary energy resources | MJ | 7,93E+01 | 2,00E-01 | 0* | 1,46E-02 | 7,90E+01 | 0* | -6,94E-02 |
| Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material | MJ | 4,15E+02 | 1,92E+00 | 5,68E-02 | 2,05E-01 | 4,12E+02 | 1,56E+00 | -7,90E-01 |
| Contribution to use of non renewable primary energy resources used as raw material | MJ | 1,81E-01 | 1,81E-01 | 0* | 0* | 0* | 0* | 0,00E+00 |
| Contribution to total use of non-renewable primary energy resources | MJ | 4,16E+02 | 2,10E+00 | 5,68E-02 | 2,05E-01 | 4,12E+02 | 1,56E+00 | -7,90E-01 |
| Contribution to use of secondary material | kg | 1,99E-03 | 1,99E-03 | 0* | 0* | 0* | 0* | 0,00E+00 |
| Contribution to use of renewable secondary fuels | MJ | 0,00E+00 | 0* | 0* | 0* | 0* | 0* | 0,00E+00 |
| Contribution to use of non renewable secondary fuels | MJ | 0,00E+00 | 0* | 0* | 0* | 0* | 0* | 0,00E+00 |
| Contribution to net use of freshwater | m³ | 1,52E-02 | 1,44E-03 | 0* | 1,95E-04 | 1,33E-02 | 2,23E-04 | -5,92E-04 |
| Contribution to hazardous waste disposed | kg | 1,32E+00 | 1,01E+00 | 0* | 2,32E-04 | 3,02E-01 | 1,33E-02 | -6,06E-01 |
| Contribution to non hazardous waste disposed | kg | 2,47E+00 | 7,16E-02 | 0* | 6,38E-02 | 2,32E+00 | 5,89E-03 | -2,54E-01 |
| Contribution to radioactive waste disposed | kg | 5,25E-04 | 2,96E-05 | 1,02E-07 | 8,56E-06 | 4,87E-04 | 2,77E-07 | -2,10E-05 |
| Contribution to components for reuse | kg | 0,00E+00 | 0* | 0* | 0* | 0* | 0* | 0,00E+00 |
| Contribution to materials for recycling | kg | 1,81E-02 | 0* | 0* | 1,08E-02 | 0* | 7,37E-03 | 0,00E+00 |
| Contribution to materials for energy recovery | kg | 0,00E+00 | 0* | 0* | 0* | 0* | 0* | 0,00E+00 |
| Contribution to exported energy | MJ | 0,00E+00 | 0* | 0* | 0* | 0* | 0* | 0,00E+00 |
| Contribution to biogenic carbon content of the product | kg de C | 0,00E+00 | 0* | 0* | 0* | 0* | 0* | 0,00E+00 |
| Contribution to biogenic carbon content of the associated packaging | kg de C | 0,00E+00 | 0* | 0* | 0* | 0* | 0* | 0,00E+00 |

* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version v5.9.4, database version 2022-01 in compliance with ISO14044.

Detailed results, including all the optional indicators mentioned in PCRed4, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

| | | | |
|---|----------------------|-------------------------------------|--|
| Registration number : | SCHN-00976-V02.01-EN | Drafting rules | PEP-PCR-ed4-2021 09 06 |
| Verifier accreditation N° | VH48 | Supplemented by | PSR-0005-ed2-2016 03 29 |
| Date of issue | 2023/09 | Information and reference documents | www.pep-ecopassport.org |
| | | Validity period | 5 years |
| Independent verification of the declaration and data, in compliance with ISO 14025 : 2010 | | | |
| Internal External X | | | |
| The PCR review was conducted by a panel of experts chaired by Julie ORGELET (DDemain) | | | |
| PEP are compliant with XP C08-100-1 :2016 or EN 50693:2019 | | | |
| The elements of the present PEP cannot be compared with elements from another program. | | | |
| Document in compliance with ISO 14025 : 2010 « Environmental labels and declarations. Type III environmental declarations » | | | |



Schneider Electric Industries SAS

Country Customer Care Center
<http://www.se.com/contact>

35, rue Joseph Monier
 CS 30323
 F- 92500 Rueil Malmaison Cedex
 RCS Nanterre 954 503 439
 Capital social 928 298 512 €

www.se.com

SCHN-00976-V02.01-EN

Published by Schneider Electric

©2023 - Schneider Electric – All rights reserved

09/2023